



INSTYTUT TECHNIKI BUDOWLANEJ



Member of



www.eota.eu

European Technical Assessment

**ETA-22/0455
of 15/07/2025**



General Part

Technical Assessment Body issuing the European Technical Assessment

Instytut Techniki Budowlanej

Trade name of the construction product

TDA and TDALS drop-in fasteners

Product family to which the construction product belongs

Deformation-controlled expansion fasteners for use in concrete for redundant non-structural systems

Manufacturer

Trutek Fasteners Polska Sp. z o.o.
ul. Wojska Polskiego 3
39-300 Mielec, Poland
e-mail: info@trutek.com.pl
www.trutek.com.pl
www.trutekfasteners.eu

Manufacturing plant

Trutek plants

This European Technical Assessment contains

15 pages including 3 Annexes which form an integral part of this Assessment

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of

European Assessment Document (EAD)
330747-00-0601 "Fasteners for use in concrete for redundant non-structural systems"

This version replaces

ETA-22/0455 issued on 16/05/2025

This European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Specific Part

1 Technical description of the product

TDA and TDALS drop-in fasteners are deformation-controlled expansion fasteners, made of carbon steel.

The fastener is installed in a drilled hole and anchored by deformation-controlled expansion.

The products description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document (EAD)

The performances given in clause 3 are only valid if the fastener is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the fastener of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer or Technical Assessment Body, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Performance of the product

3.1.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	Annex C3

3.1.2 Safety and accessibility in use (BWR 4)

Essential characteristic	Performance
Characteristic resistance for all load directions	Annex C1 and C2
Durability	Annex A3 and B1

3.2 Methods used for the assessment

The assessment has been made in accordance with EAD 330747-00-0601.

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

According to Decision 97/161/EC of the European Commission the system 2+ of assessment and verification of constancy of performance applies (see Annex V to regulation (EU) No 305/2011).


5 Technical details necessary for the implementation of the AVCP system, as provided in the applicable European Assessment Document (EAD)

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited in Instytut Techniki Budowlanej.

For type testing the results of the tests performed as part of the assessment for the European Technical Assessment shall be used unless there are changes in the production line or plant. In such cases the necessary type testing has to be agreed between Instytut Techniki Budowlanej and the notified body.

Issued in Warsaw on 15/07/2025 by Instytut Techniki Budowlanej

Anna Panek, MSc
Deputy Director of ITB

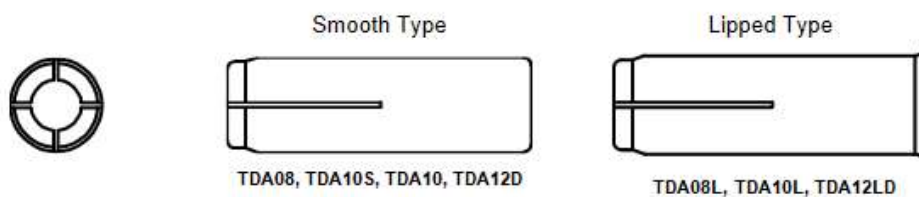

Marking on the body

1. TDA anchor identification and type
XX – size

2.  producer identification mark

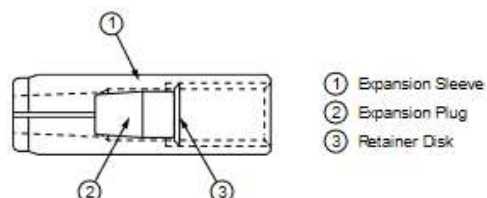


Table A1. Dimensions of TDA fasteners

Fastener			TDA08 TDA08L	TDA10S TDA10L	TDA10 TDA10L	TDA12D TDA12LD
Size			M8x30	M10x30	M10x40	M12x50
Expansion sleeve						
Sleeve diameter	D	[mm]	10	12	12	16
Sleeve length	L	[mm]	30	30	40	50
Thread	d	[-]	M8	M10	M10	M12
Thread length	L _{th}	[mm]	13	13	19	22
Expansion plug						
Plug diameter	d ₁	[mm]	6,50	8,00	8,10	10,15
	d ₂	[mm]	5,55	6,93	6,50	8,50
Plug length	L _c	[mm]	12,00	11,10	15,25	20,00

TDA and TDALS drop-in fasteners

Product description
Characteristics of the product – TDA fasteners

Annex A1
of European
Technical Assessment
ETA-22/0455

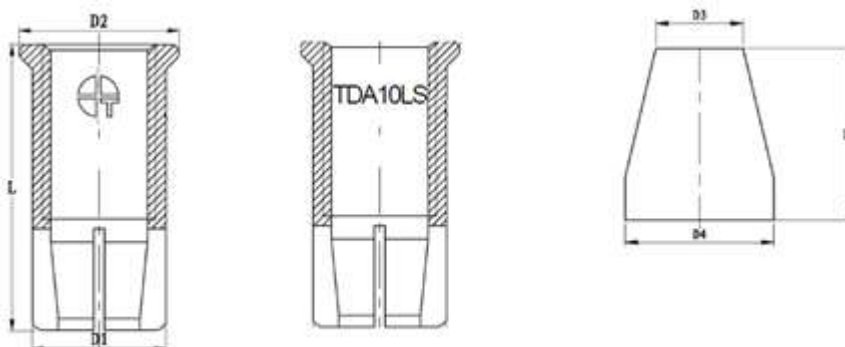


Table A2. Dimensions of TDALS fasteners

Fastener			TDA08LS	TDA10LS	TDA12LS
Size			M8x25	M10x25	M12x25
Expansion sleeve					
Sleeve diameter	D1	[mm]	9,90 - 10,00	11,90 - 12,00	14,90 - 15,00
	D2	[mm]	11,90 ± 0,2	13,90 ± 0,2	17,00 ± 0,2
Sleeve length	L	[mm]	24,80 - 25,30	24,80 - 25,30	24,80 - 25,30
Thread	-	[-]	M8	M10	M12
Expansion plug					
Plug diameter	D3	[mm]	5,10 ± 0,1	7,00 ± 0,1	8,00 ± 0,1
	D4	[mm]	6,30 ± 0,1	8,00 ± 0,1	9,80 ± 0,1
Plug length	L1	[mm]	8,00 ± 0,5	8,00 ± 0,5	8,00 ± 0,5

TDA and TDALS drop-in fasteners

Product description
 Characteristics of the product – TDALS fasteners

Annex A2
 of European
 Technical Assessment
 ETA-22/0455

Table A3. Materials

Element	Material		
Expansion sleeve	Carbon steel	$f_{uk} \geq 325 \text{ MPa}$ $f_{yk} \geq 185 \text{ MPa}$	Electroplated zinc coating $\geq 5 \mu\text{m}$ according to EN ISO 4042
Expansion plug		$f_{uk} \geq 315 \text{ MPa}$ $f_{yk} \geq 195 \text{ MPa}$	


Table A4. Dimensions of installation pins

Fastener			TDA08 TDA08L	TDA10S TDA10L	TDA10 TDA10L	TDA12D TDA12LD	TDA08LS	TDA10LS	TDA12LS
Size			M8x30	M10x30	M10x40	M12x50	M8x25	M10x25	M12x25
Setting pin diameter	D_s	[mm]	6,50	8,00	8,00	10,20	6,40	8,20	10,00
Setting pin length	H_s	[mm]	18,00	18,00	24,00	30,00	15,00	16,00	10,40

TDA and TDALS drop-in fasteners
Product description
Materials and dimension of installation pins

Annex A3
of European
Technical Assessment
ETA-22/0455

Specification of intended use

Anchorage subject to:

- Multiple use for non-structural application.
- Static and quasi-static loads.
- Anchorages with requirements related to resistance to fire.

Base material:

- Reinforced or unreinforced normal weight concrete (without fibres) of strength class C20/25 to C50/60 according to EN 206.
- Uncracked and cracked concrete.
- Pre-stressed hollow core slabs of strength class C30/37 to C50/60: TDALS fasteners only.

Use conditions (environmental conditions):

- Anchorages subject to dry internal conditions.


Design:

- Anchorages are designed under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be transmitted. The position of the fastener is indicated on the design drawings (e.g. position of the fastener relative to reinforcement or to supports, etc.).
- Anchorages under static and quasi-static loads and under fire exposure are designed in accordance with EN 1992-4:2018.
- Fasteners are only to be used for multiple use for non-structural applications according to EAD 330747-00-0601.

Installation:

- Fastener installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.
- Use of the fastener only as supplied by the manufacturer without exchanging any component of the fastener.
- Fastener installation in accordance with the manufacturer's specifications and drawings and using the appropriate tools.
- Check of concrete being well compacted, e.g. without significant voids.
- Positioning of the drill holes without damaging the reinforcement.
- In case of aborted hole: new drilling at a minimum distance away of twice the depth of the aborted hole or smaller distance if the aborted drill hole is filled with high strength mortar and if under shear or oblique tension load it is not in the direction of load application.
- Fastener installation such that the effective anchorage depth is complied with.

TDA and TDALS drop-in fasteners	Annex B1 of European Technical Assessment ETA-22/0455
Intended use Specifications	

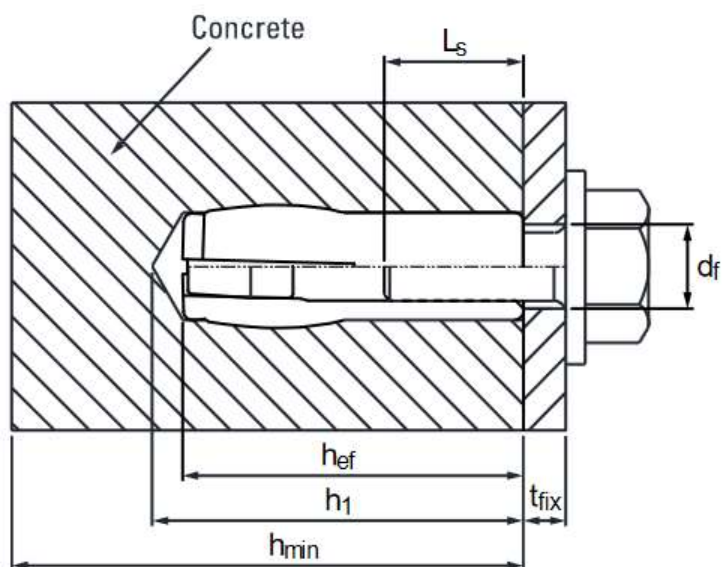
Table B1. Installation parameters of TDA and TDALS fasteners in concrete

Fastener			TDA08LS	TDA10LS	TDA12LS	TDA08 TDA08L	TDA10S TDA10L	TDA10 TDA10L	TDA12D TDA12LD
Size			M8x25	M10x25	M12x25	M8x30	M10x30	M10x40	M12x50
Effective anchorage depth	h_{ef}	[mm]	25	25	25	30	30	40	50
Drill hole depth	h_1	[mm]	27	27	27	33	33	43	54
Drill hole diameter	d_0	[mm]	10	12	15	10	12	12	16
Maximum installation torque	T_{inst}	[Nm]	11	17	38	11	17	17	38
Minimum thickness of concrete member	h_{min}	[mm]	80	80	80	80	80	80	100
Minimum screwing depth	$L_{s,min}$	[mm]	7	8	10	8	10	10	12
Maximum screwing depth	$L_{s,max}$	[mm]	12	13	13	13	13	19	22
Diameter of clearance hole in the fixture	d_f	[mm]	8	10	12	9	12	12	14
Minimum spacing	s_{min}	[mm]	200	200	200	200	200	200	250
Minimum edge distance	c_{min}	[mm]	150	150	150	150	150	150	150

Fastening screws or threaded rods:

Steel, property class 4.8 / 5.8 / 6.8 / 8.8 according to EN-ISO 898-1; thickness of zinc coating $\geq 5 \mu m$
TDA and TDALS drop-in fasteners
Intended use
Installation parameters

Annex B2
of European
Technical Assessment
ETA-22/0455

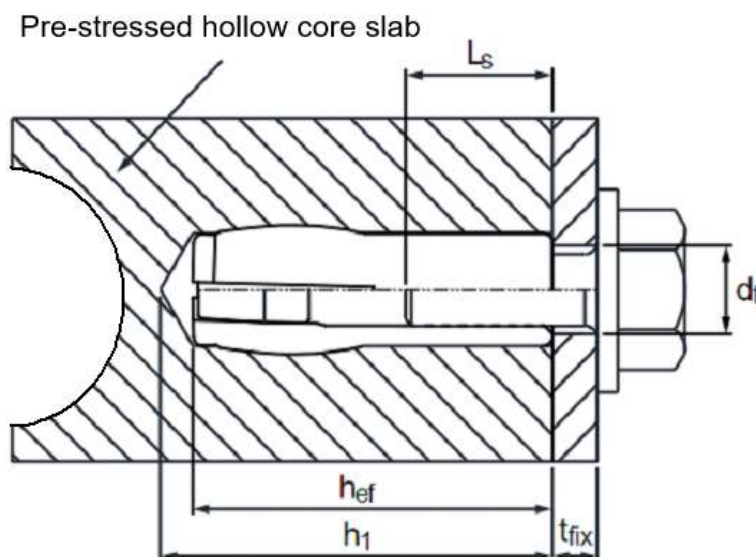


Table B2. Installation parameters of TDALS fasteners in pre-stressed hollow concrete slab

Fastener			TDA08LS	TDA10LS	TDA12LS
Size			M8x25	M10x25	M12x25
Effective anchorage depth	$h_{ef} = h_{nom}$	[mm]	25	25	25
Drill hole depth	h_1	[mm]	27	27	27
Drill hole diameter	d_0	[mm]	10	12	15
Maximum installation torque	T_{inst}	[Nm]	11	17	38
Minimum screwing depth	$L_{s,min}$	[mm]	7	8	10
Maximum screwing depth	$L_{s,max}$	[mm]	12	13	13
Diameter of clearance hole in the fixture	d_f	[mm]	8	10	12
Minimum spacing	s_{min}	[mm]	200	200	200
Minimum edge distance	c_{min}	[mm]	150	150	150

Fastening screws or threaded rods:


Steel, property class 4.8 / 5.8 / 6.8 / 8.8 according to EN-ISO 898-1; thickness of zinc coating $\geq 5 \mu m$

TDA and TDALS drop-in fasteners


Intended use

Installation parameters in pre-stressed core slab – TDALS fasteners


Annex B3
of European
Technical Assessment
ETA-22/0455

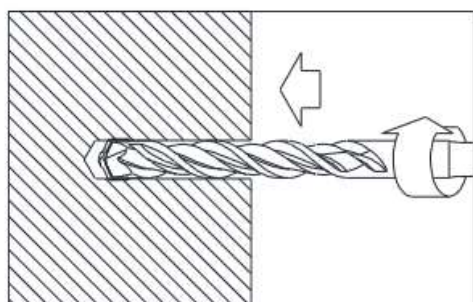


Drill hole with metal hammer drill machine.
Drill to a required depth.

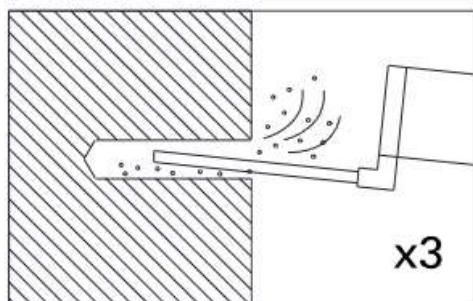

Blow out dust at least 3 times with a hand pump.

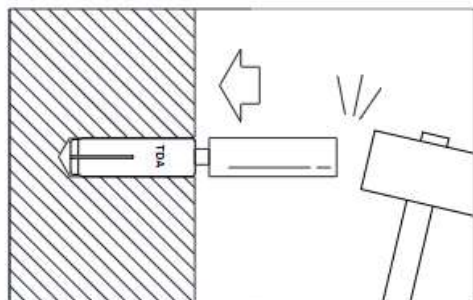

Put the fastener into the drill hole, hammering with the installation tool (pin), until the setting pin fully insert into the fastener.

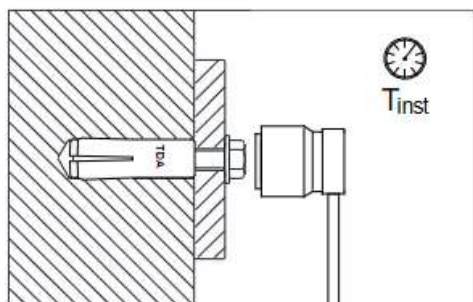


Fix the fixture by screw or threaded rod with max. T_{inst} .


TDA and TDALS drop-in fasteners

Intended use
Installation instructions and tools in concrete


Annex B4
of European
Technical Assessment
ETA-22/0455

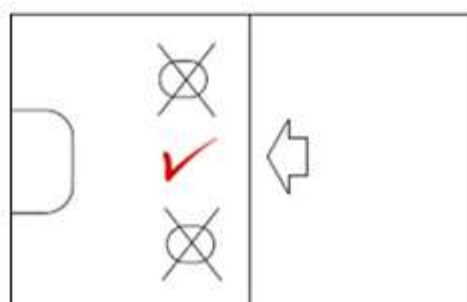


Find admissible fastener position before drilling.

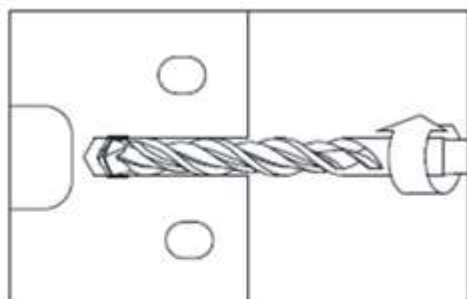


Drill hole with rotary percussive machine.
Drill to a required depth.

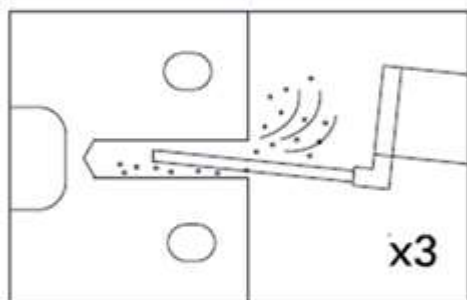

Blow out dust at least 3 times with a hand pump.

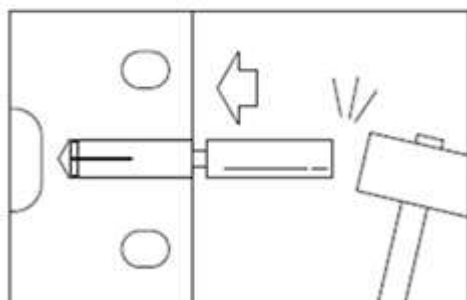

Put the fastener into the drill hole, hammering with the installation tool (pin), until the setting pin fully insert into the fastener.

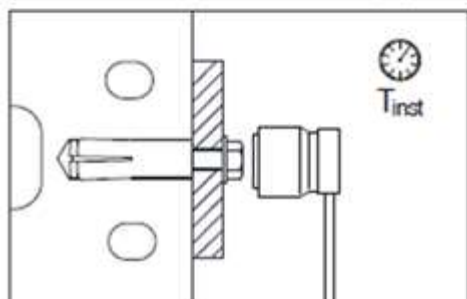

Fix the fixture by screw or threaded rod with max. T_{inst} .

TDA and TDALS drop-in fasteners

Intended use

Installation instructions and tools in pre-stressed hollow core slab

Annex B5
of European
Technical Assessment
ETA-22/0455

Table C1: Characteristic resistance in concrete C20/25 to C50/60

Fastener			TDA08LS	TDA10LS	TDA12LS	TDA08 TDA08L	TDA10S TDA10L	TDA10 TDA10L	TDA12D TDA12LD
Size			M8x25	M10x25	M12x25	M8x30	M10x30	M10x40	M12x50
All load directions (fastening screw or threaded rod property class ≥ 4.8)									
Characteristic resistance in concrete C20/25 to C50/60	F_{Rk}^0	[kN]	2,5	4,0	4,0	4,0	4,5	4,5	7,0
Installation safety factor	γ_{inst}	[-]	1,0	1,0	1,0	1,4	1,4	1,2	1,2
Partial safety factor	$\gamma_M^{1)}$	[-]	1,5	1,5	1,5	1,5	1,5	1,5	1,5
Spacing	s_{cr}	[mm]	200	200	200	200	200	200	250
Edge distance	c_{cr}	[mm]	150	150	150	150	150	150	150
Minimum member thickness	h_{min}	[mm]	80	80	80	80	80	80	100
Shear load: steel failure with lever arm									
Characteristic bending moment: property class 4.8	$M_{Rk,s}^0$	[Nm]	15,0	29,9	52,4	15,0	30,0	30,0	52,4
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25	1,25	1,25	1,25	1,25
Characteristic bending moment: property class 5.8	$M_{Rk,s}^0$	[Nm]	19,0	37,0	65,6	19,0	37,0	37,0	65,6
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25	1,25	1,25	1,25	1,25
Characteristic bending moment: property class 6.8	$M_{Rk,s}^0$	[Nm]	22,5	44,9	78,7	23,0	45,0	45,0	78,7
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25	1,25	1,25	1,25	1,25
Characteristic bending moment: property class 8.8	$M_{Rk,s}^0$	[Nm]	30,0	59,9	104,9	30,0	60,0	60,0	104,9
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25	1,25	1,25	1,25	1,25
¹⁾ in the absence of other national regulation									

TDA drop-in fasteners

Performance
Characteristic resistance in concrete

Annex C1
of European
Technical Assessment
ETA-22/0455

Table C2: Characteristic resistance in pre-stressed hollow core slab C30/37 to C50/60

Fastener			TDA08LS	TDA10LS	TDA12LS
Size			M8x25	M10x25	M12x25
All load directions (fastening screw or threaded rod property class ≥ 4.8)					
Bottom flange thickness	d_b	mm	≥ 35	≥ 35	≥ 35
Characteristic resistance in pre-stressed concrete hollow slab C30/37 to C50/60	F_{Rk}^0	[kN]	6,0	6,5	7,0
Installation safety factor	γ_{inst}	[-]	1,0	1,0	1,0
Partial safety factor	$\gamma_M^{1)}$	[-]	1,25	1,25	1,25
Spacing	s_{cr}	[mm]	200	200	250
Edge distance	c_{cr}	[mm]	150	150	150
Minimum member thickness	h_{min}	[mm]	35	35	35
Shear load: steel failure with lever arm					
Characteristic bending moment: property class 4.8	$M_{Rk,s}^0$	[Nm]	15,0	29,9	52,4
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25
Characteristic bending moment: property class 5.8	$M_{Rk,s}^0$	[Nm]	18,8	37,4	65,6
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25
Characteristic bending moment: property class 6.8	$M_{Rk,s}^0$	[Nm]	22,5	44,9	78,7
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25
Characteristic bending moment: property class 8.8	$M_{Rk,s}^0$	[Nm]	30,0	59,9	104,9
Partial safety factor	$\gamma_{Ms}^{1)}$	[-]	1,25	1,25	1,25
¹⁾ in the absence of other national regulation					

TDA and TDALS drop-in fasteners

Performance
Characteristic resistance in pre-stressed hollow core slab

Annex C2
of European
Technical Assessment
ETA-22/0455

Table C3: Characteristic resistance under fire exposure in concrete C20/25 to C50/60

Fastener		TDA08 TDA08L	TDA10S TDA10L	TDA10 TDA10L	TDA12D TDA12LD
Size		M8x30	M10x30	M10x40	M12x50
Fire resistance class (fastening screw or threaded rod property class ≥ 4.8)					
R30	Characteristic resistance $F_{Rk,fi}^{0,1)}$	[kN]	0,89	0,89	1,13
R60		[kN]	0,89	0,89	1,13
R90		[kN]	0,89	0,89	1,13
R120		[kN]	0,71	0,71	0,90
Spacing	$S_{cr,fi}$	[mm]	4 x h_{ef}		
Edge distance	$C_{cr,fi}$	[mm]	2 x h_{ef}		

The design method covers fasteners with a fire attack from one side only. In case of fire attack from more than one side, the edge distance shall be ≥ 300 mm.

¹⁾ in the absence of other national regulation a partial safety factor $\gamma_{M,fi} = 1,0$ is recommended

TDA and TDALS drop-in fasteners

Performance
Characteristic resistance under fire exposure in concrete

Annex C3
of European
Technical Assessment
ETA-22/0455